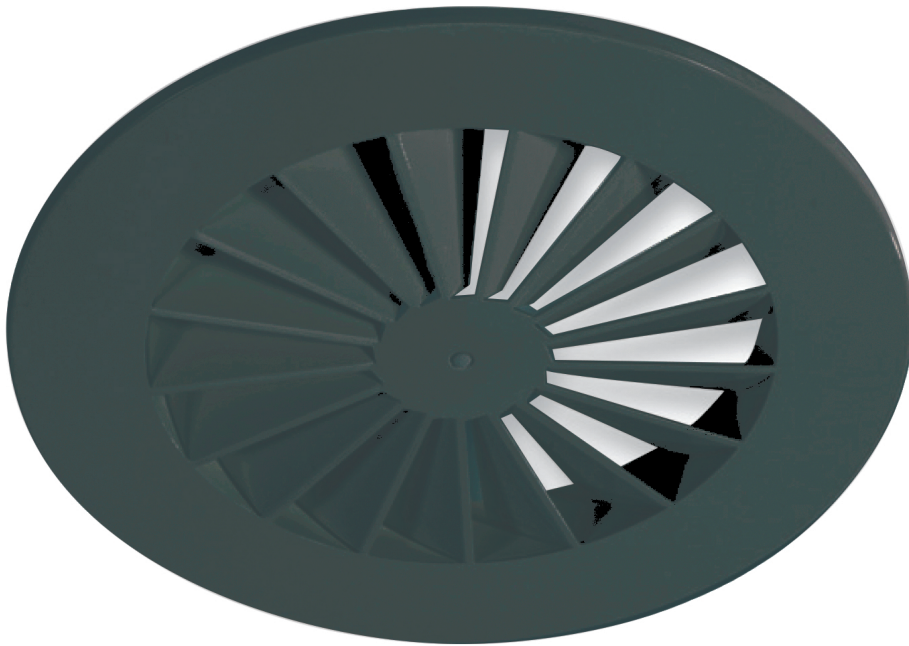


**RWR-N
(RAL9005)**

- Swirl diffusers
- Circular
- Steel
- Black, RAL 9005

CAIROX

Black circular swirl diffusers with fixed blades type RWR-N (RAL9005)

Circular swirl ceiling diffusers with fixed blades

Brand

- Cairox

Application

- For air supply and exhaust in ventilation and air conditioning systems.

Material

- Steel

Colour

- Colour black, RAL 9005
- Other colours available upon request

Composition

- Fixed blades

Mounting

- Fixing with central screw into the crossbar of the plenum box

Accessories

- Plenum box, type **RER-LB**
- Insulated plenum box, type **RER-LB ISO**
- Regulating valve for plenum box, type **CRC**
- Mounting crossbar for direct duct mounting, type **FGN**
- Mounting crossbar for direct ceiling mounting, type **FHN**

Text for tender

- The air supply diffusers are of the swirl type with fixed blades. They are made of steel with black powder coating RAL 9005 and supplied with a volume control damper in the plenum box.
- **Cairox type RWR-N RAL9005+RER-L**

Order example

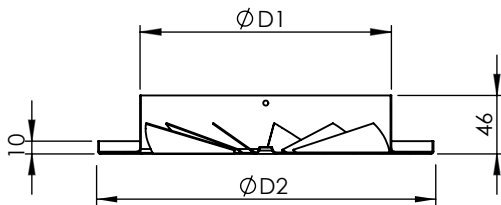
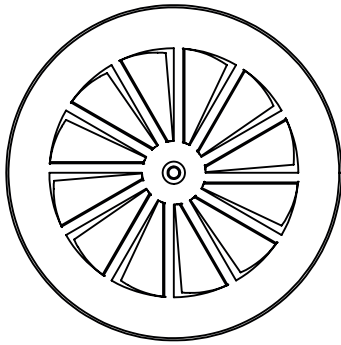
- **RWR-N RAL9005, 315 + RER-LB + CRC 250**

Explanation

RWR-N RAL9005 = Diffuser type

315 = Diffuser size (Ø diffuser neck connection)

Accessories

RER-LB = Plenum box**CRC** = Regulating valve for plenum box**250** = Plenum box connection diameter

RWR-N	Dimensions		
	ØD1 [mm]	ØD2 [mm]	#Blades
125	123	171	8
160	158	214	10
200	198	264	12
250	248	326	14
315	313	404	16
355	353	448	18
400	398	500	18
500	498	596	20

		Quick selection																								
RWR-N		125			160			200			250			315			355			400			500			
Q	Ak	1.2	2.4	3.6	1.2	2.4	3.6	1.2	2.4	3.6	1.2	2.4	3.6	1.2	2.4	3.6	1.2	2.4	3.6	1.2	2.4	3.6	1.2	2.4	3.6	
50	B	0.0099																								
	Vz	H= 2.7	0.08	0.05	0.04																					
		H= 3.2	0.06	0.04	0.04																					
		H= 3.8	0.04	0.04	0.03																					
		Vk		1.4																						
		X0.25		0.5																						
100	Vz	H= 2.7	0.15	0.11	0.08	0.14	0.1	0.08	0.11	0.08	0.06															
		H= 3.2	0.11	0.09	0.07	0.1	0.08	0.06	0.09	0.07	0.05															
		H= 3.8	0.09	0.07	0.06	0.08	0.06	0.05	0.07	0.05	0.05															
		Vk		2.8			2.3			1.6																
		X0.25		0.9			0.8			0.7																
		Ps		45			19			6																
150	Vz	H= 2.7	0.23	0.16	0.13	0.21	0.15	0.11	0.17	0.12	0.1	0.15	0.11	0.08												
		H= 3.2	0.17	0.13	0.11	0.15	0.12	0.1	0.13	0.1	0.08	0.11	0.09	0.07												
		H= 3.8	0.13	0.11	0.09	0.12	0.1	0.08	0.1	0.08	0.07	0.09	0.07	0.06												
		Vk		4.2			3.4			2.4																
		X0.25		1.4			1.2			1																
		Ps		100			41			14																
200	Vz	H= 2.7	0.31	0.22	0.17	0.27	0.2	0.15	0.23	0.16	0.13	0.2	0.14	0.11	0.17	0.12	0.09	0.18	0.13	0.1						
		H= 3.2	0.23	0.18	0.14	0.21	0.16	0.13	0.17	0.13	0.11	0.15	0.12	0.09	0.13	0.1	0.08	0.13	0.1	0.08						
		H= 3.8	0.18	0.14	0.12	0.16	0.13	0.11	0.13	0.11	0.09	0.12	0.09	0.08	0.1	0.08	0.07	0.1	0.08	0.07						
		Vk		5.6			4.5			3.2																
		X0.25		1.8			1.6			1.4																
		Ps		178			72			25																
300	Vz	H= 2.7							0.34	0.25	0.19	0.3	0.22	0.17	0.25	0.18	0.14	0.27	0.19	0.15	0.23	0.16	0.13	0.24	0.17	0.13
		H= 3.2							0.26	0.2	0.16	0.23	0.17	0.14	0.19	0.14	0.12	0.2	0.16	0.13	0.17	0.13	0.11	0.18	0.14	0.11
		H= 3.8							0.2	0.16	0.14	0.17	0.14	0.12	0.14	0.12	0.1	0.16	0.13	0.11	0.13	0.11	0.09	0.14	0.11	0.09
		Vk								4.7																
		X0.25								2.1																
		Ps								54																
400	Vz	H= 2.7										0.4	0.29	0.22	0.33	0.24	0.19	0.36	0.26	0.2	0.3	0.22	0.17	0.24	0.17	0.13
		H= 3.2										0.3	0.23	0.19	0.25	0.19	0.16	0.27	0.21	0.17	0.23	0.18	0.14	0.18	0.14	0.11
		H= 3.8										0.23	0.19	0.16	0.19	0.16	0.13	0.21	0.17	0.14	0.18	0.14	0.12	0.14	0.11	0.09
		Vk																								
		X0.25																								
		Ps																								
500	Vz	H= 2.7																								
		H= 3.2																								
		H= 3.8																								
		Vk																								
		X0.25																								
		Ps																								
600	Vz	H= 2.7																								
		H= 3.2																								
		H= 3.8																								
		Vk																								
		X0.25																								
		Ps																								
800	Vz	H= 2.7																								
		H= 3.2																								
		H= 3.8																								
		Vk																								
		X0.25																								
		Ps																								
1000	Vz	H= 2.7																								
		H= 3.2																								
		H= 3.8																								
		Vk																								
		X0.25																								
		Ps																								
1200	Vz	H= 2.7																								
		H= 3.2																								
		H= 3.8																								
		Vk																								
		X0.25																								
		Ps																								

Symbols and specifications

- Q = Air volume in m³/h
- Ak = Effective surface (free area) in m²
- B = Distance between the diffusers in m
- H = Installation height of the diffusers in m
- Vz = Maximum velocity at the occupied zone according to distance between the diffusers and installation height in m/s
- Vk = Average effective velocity through the diffuser in m/s
- X0.25 = Throw length in m at an end velocity Vt of 0,25m/s
- Ps = Static pressure loss given in Pa
- Lw(A) = Acoustic power in dB(A)

- The throw X0.25 is given at an end velocity of 0.25m/s for a smooth ceiling without any obstacles.
- The values are given for isothermal supply air. Throw distances for cooling conditions at -11K can be calculated by dividing the X0.25 values with factor 1.1. For heating purposes at Dt of +11K a multiplier of 1.1 should be applied to the

given $X_{0.25}$ value.

- In order to achieve a high comfort level, selections can be made according to the maximal velocity at the occupied zone V_z . These values are given at distances between diffusers B and installation heights H . Velocities V_z lower than, or equal to $0,25\text{m/s}$ at the occupied zone are advised.
- The pressure losses P_s are given for diffusers without damper or with fully opened damper.
- The acoustic power values $L_w(A)$ are given for diffusers without damper or with fully opened damper without room attenuation. Acoustic powers below $20\text{dB}(A)$ are mentioned as " <20 " in the tables.
- For all special requirements, please contact our engineering office.

Placement instruction

