


**RWR-4 TS  
(RAL9016)**

- Swirl diffusers
- Circular
- Steel
- White, RAL 9016

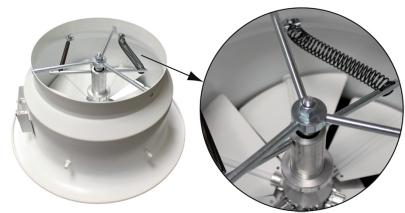

## Variable thermostatic swirl diffusers type RWR-4 TS (RAL9016)

Circular thermostatic swirl ceiling diffuser for high ceiling  
Set blade angle switches automatically between cooling and heating mode.

### **Brand**

- Cairox

### **Application**

- For air supply in ventilation and air conditioning systems.

### **Material**

- Steel and aluminium

### **Colour**

- Standard colour white, RAL 9016
- Other colours available upon request

### **Composition**

- Adjustable blades with thermostatic regulator (bimetal)
- Perforated plate in the collar of the diffuser
- $\alpha$ = Blade angle

### **Text for tender**

- The air supply diffusers are of the swirl type with adjustable blades with a thermostatic regulator (bimetal). They are made of steel and aluminium with white powder coating finish RAL 9016.
- Cairox type RWR-4 TS

### **Order example**


- RWR-4 TS, 400

Explanation

**RWR-4** = Diffuser type

**TS** = Thermostatic control element (bi-metal)

**400** = Neck size of diffuser

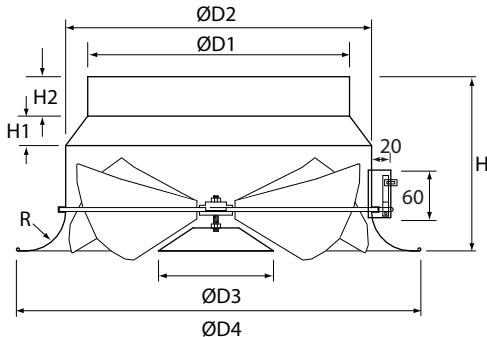


	Dimensions							
	D1 [mm]	D2 [mm]	D3 [mm]	D4 [mm]	H [mm]	H1 [mm]	H2 [mm]	R [mm]
RWR-4 200	198	248	96	350	180	20	40	30
RWR-4 250	248	298	133	400	205	30	40	30
RWR-4 315	313	398	175	500	230	30	40	30
RWR-4 400	398	465	175	615	270	45	60	60
RWR-4 500	498	565	225	780	320	35	60	80
RWR-4 630	628	665	273	935	390	25	80	100

Quick selection							
RWR-4 (TS)		200	250	315	400	500	
Q	Ak	0.0305	0.0479	0.0765	0.1238	0.194	
	Hm	2,5 - 3,8	3,0 - 5,3	3,3 - 6	4,3 - 7,5	5,5 - 16	
300	B(min)	2,4	1,6				
	Vk	2,7	1,7				
	Ps	7	3				
	Lw(A)	33	22				
400	B(min)	3	2,2				
	Vk	3,6	2,3				
	Ps	12	5				
	Lw(A)	42	30				
500	B(min)	3,8	2,8	2			
	Vk	4,6	2,9	1,8			
	Ps	19	7	3			
	Lw(A)	49	37	22			
600	B(min)		3,4	2,4	2,8		
	Vk		3,5	2,2	1,3		
	Ps		11	4	2		
	Lw(A)		42	27	20		
800	B(min)			3	2,8		
	Vk			2,9	1,8		
	Ps			8	3		
	Lw(A)			36	23		
1000	B(min)			3,8	2,8	3,4	
	Vk			3,6	2,2	1,4	
	Ps			12	5	2	
	Lw(A)			43	30	20	
2000	B(min)				5,4	4	4,2
	Vk				4,5	2,9	1,8
	Ps				19	7	3
	Lw(A)				51	38	22
3000	B(min)					6	4,4
	Vk					4,3	2,7
	Ps					17	7
	Lw(A)					50	33
4000	B(min)						5,8
	Vk						3,6
	Ps						12
	Lw(A)						42
5000	B(min)						7,2
	Vk						4,5
	Ps						19
	Lw(A)						49

### Symbols and specifications

- Q = Air Volume in m<sup>3</sup>/h
- Ak = Effective surface (free area) of the neck of the diffuser in m<sup>2</sup>
- Hm = Advised minimum - maximum mounting height in m
- Bmin = Advised minimum distance between diffusers in m
- Vk = Air velocity through the neck of the diffuser in m/s
- Ps = Static pressure loss in Pa
- Lw(A) = Acoustic power in dB(A)
- The values are given for isothermal supply air without Coanda effect.
- The values in the table are given at an inclination angle  $\alpha$  of the vanes of the diffuser set at 45°.
- In order to achieve a high comfort level, the angle of the blades are automatically altered according to air supply temperature. The minimum and maximum angle of the blades can mechanically be limited. The ideal set angles can be determined in function of the temperature difference  $\Delta t$  between the supply air and room air temperature. (see selection graphs)
- Acoustic powers below 20dB(A) are mentioned as "<20" in the tables.
- For all special requirements, please contact our engineering office.

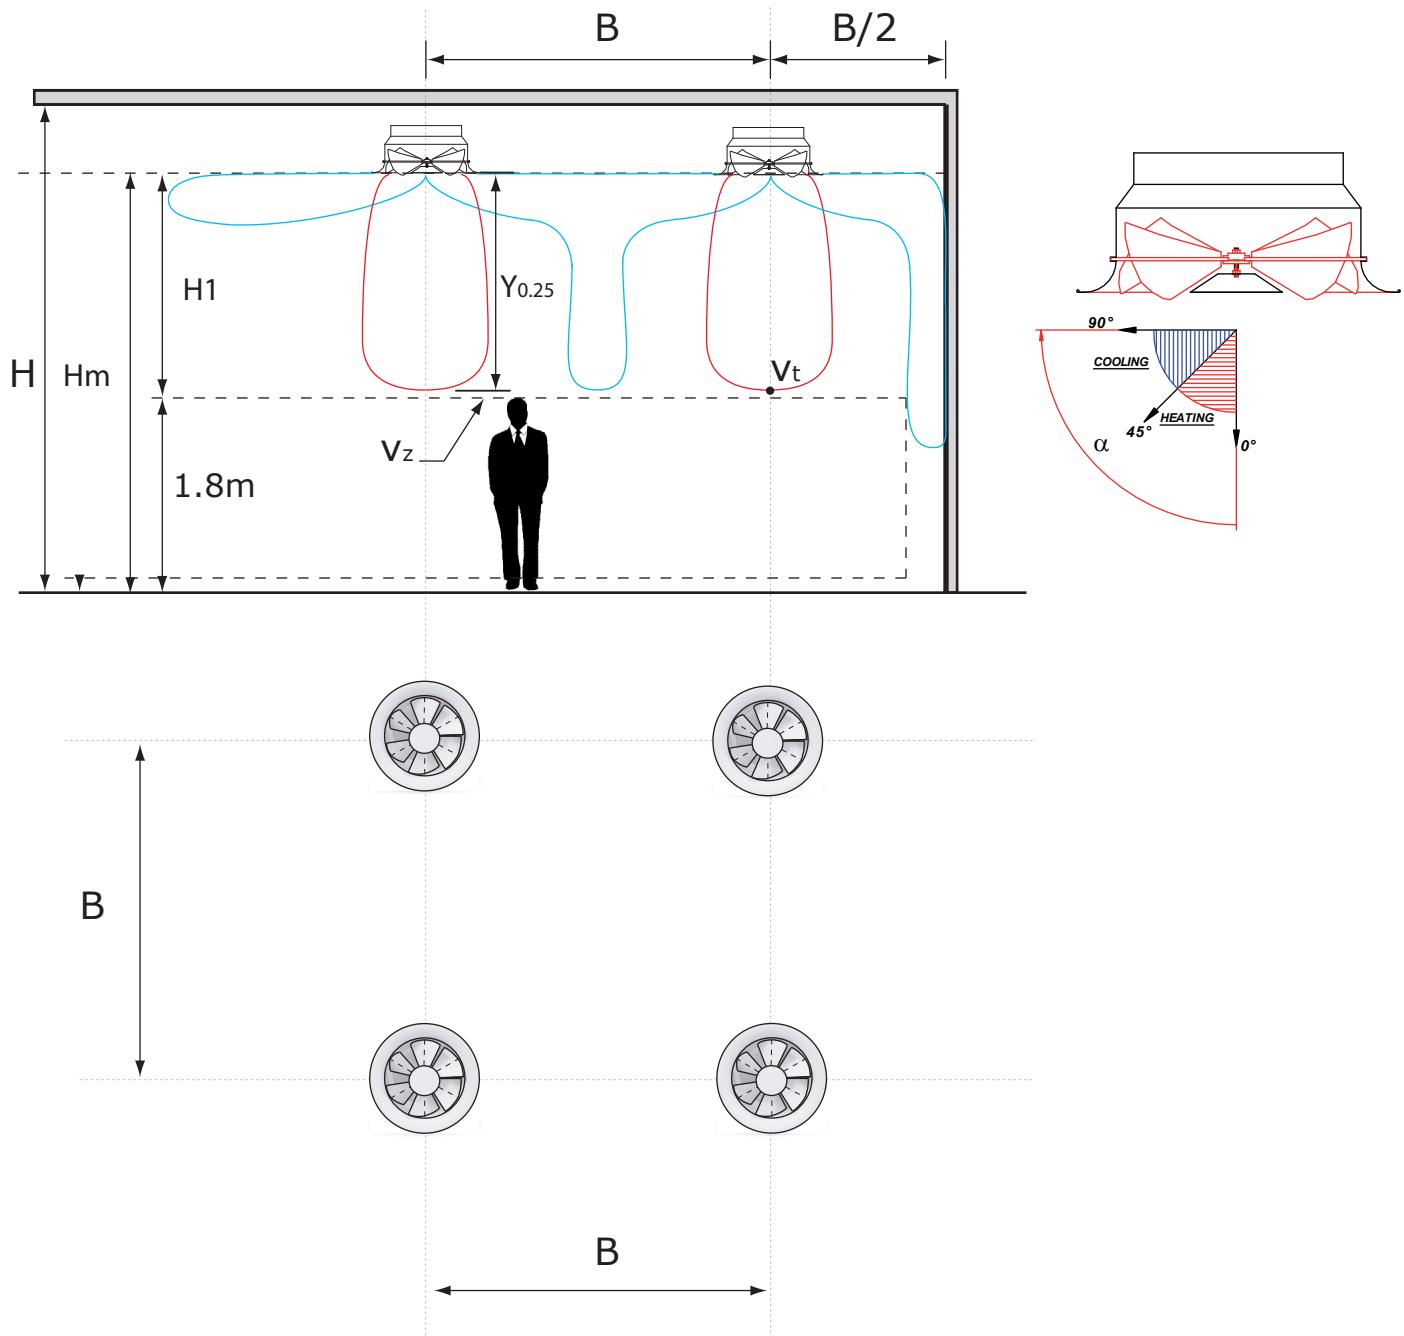
**Placement instruction**



**Noise selection table**

$$\alpha = 45^\circ$$

  35 < (LwA [dB(A)]) < 20

  50 < (LwA [dB(A)]) < 35


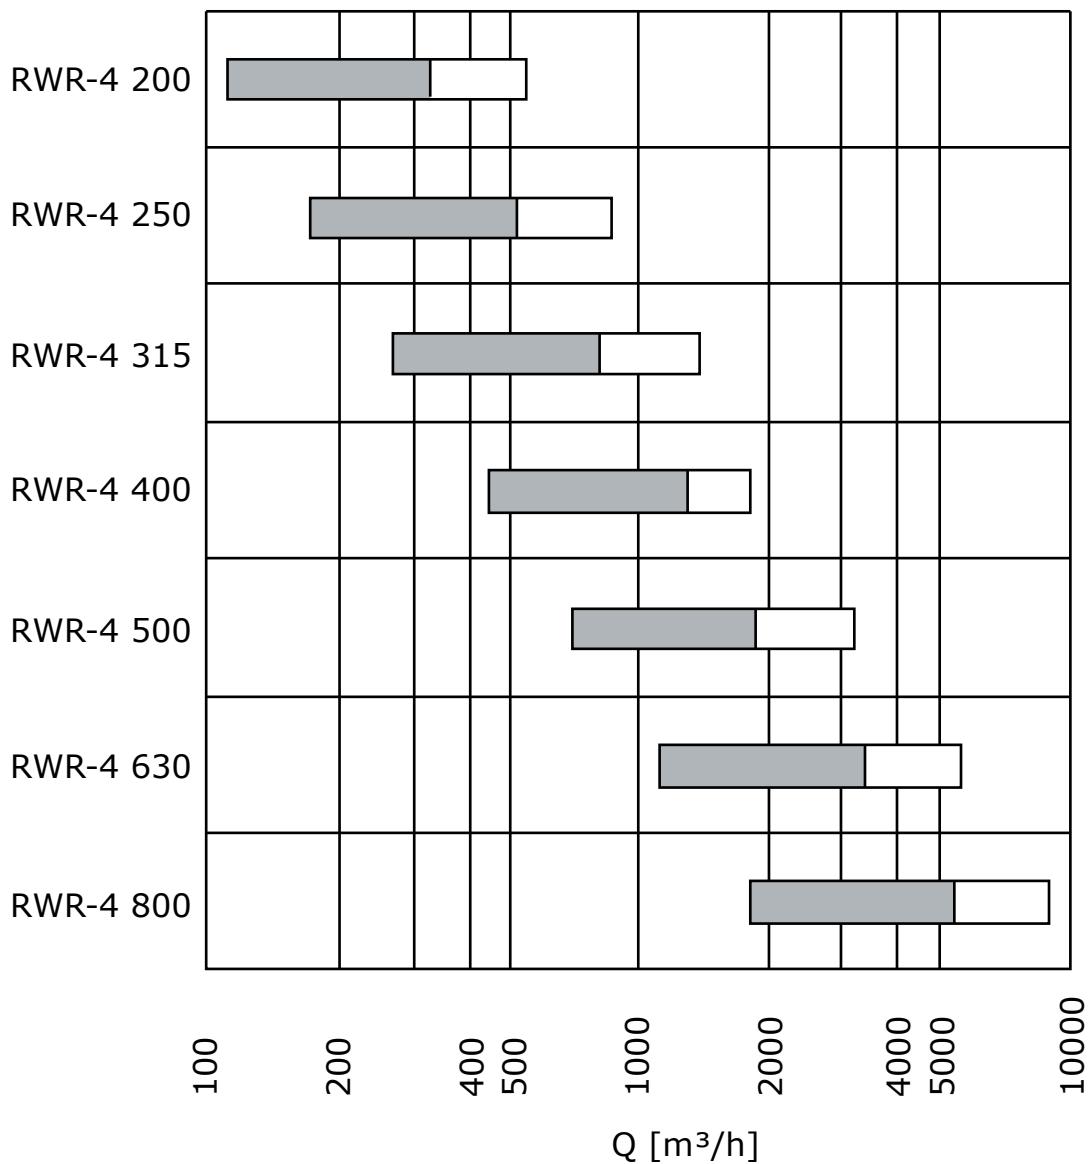


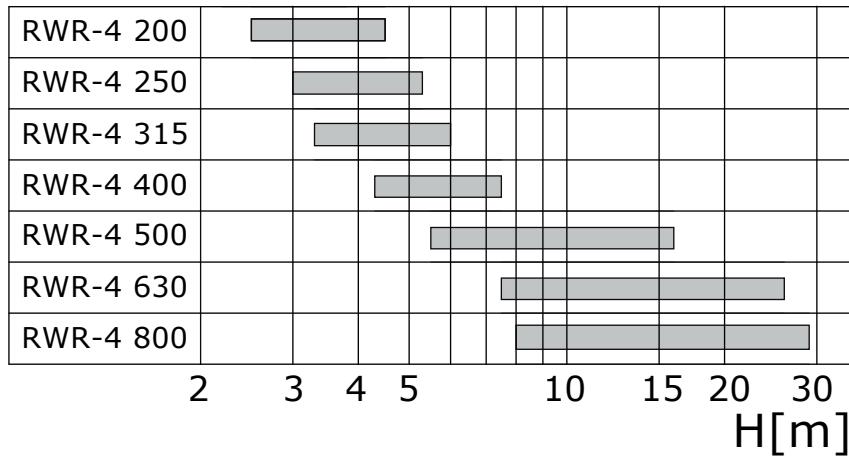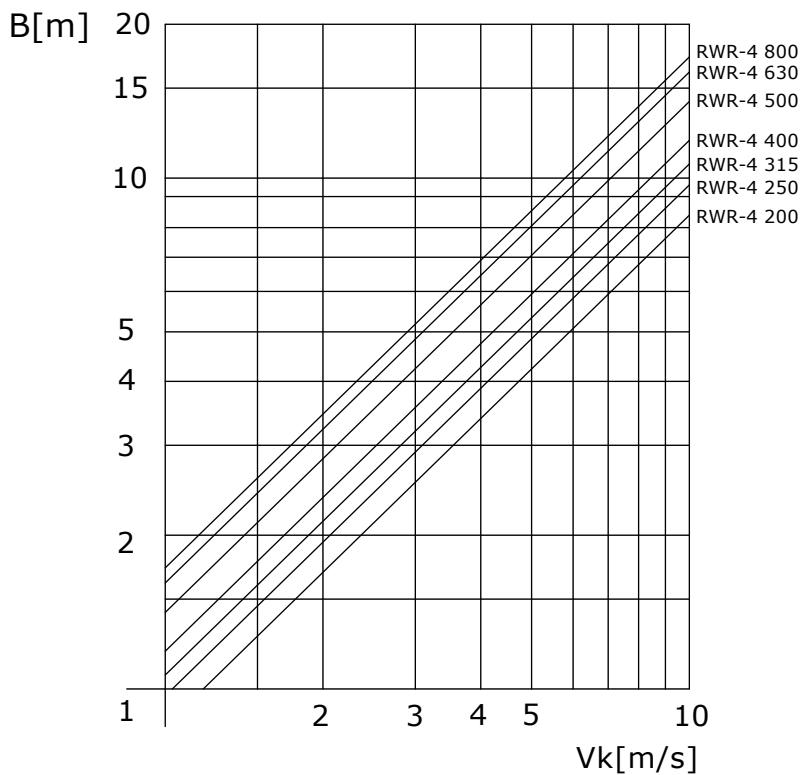**Placement height selector****Minimum distance selection**



**Angle setting size 200**

$\alpha$ -setting RWR-4 200





## COOLING

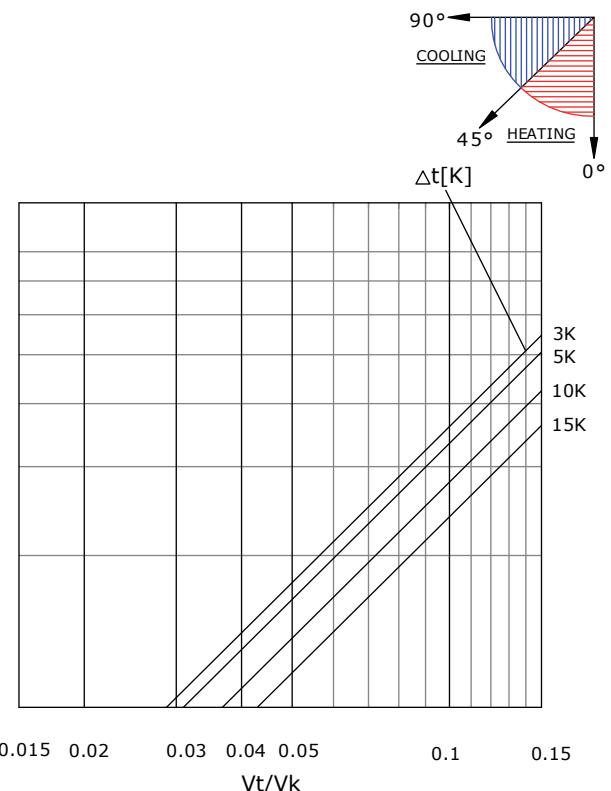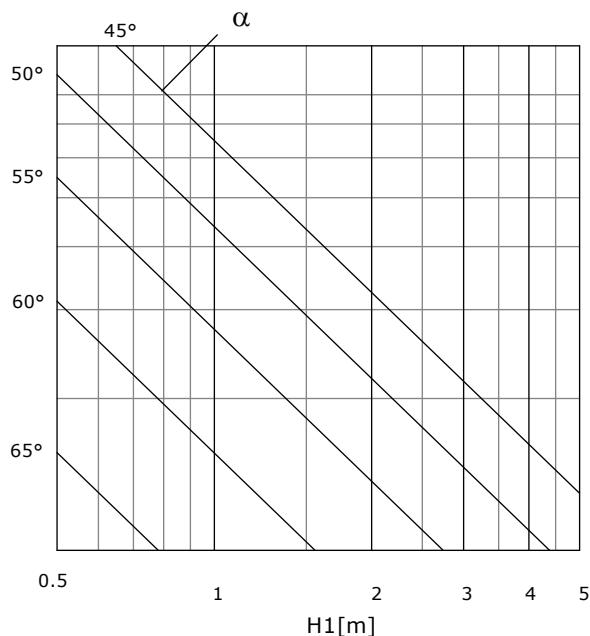

## HEATING

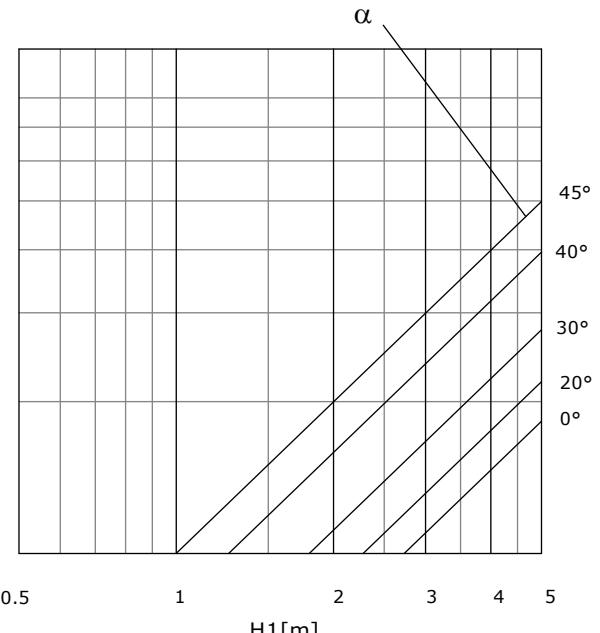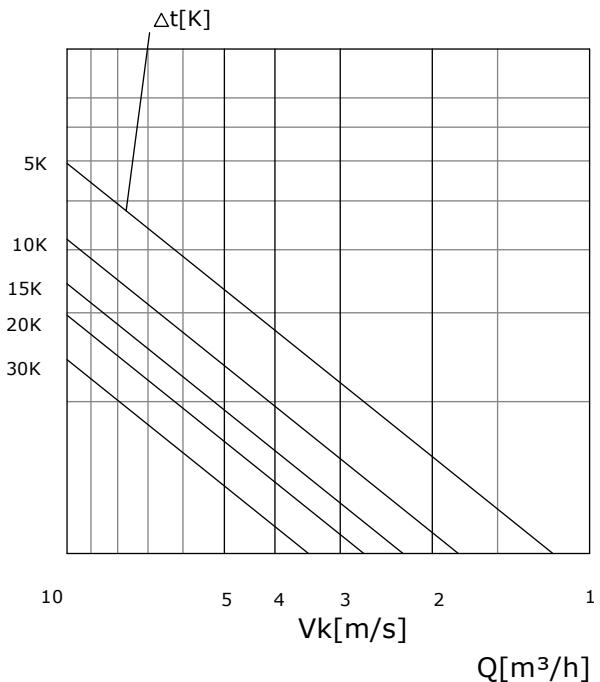



**Angle setting size 250**

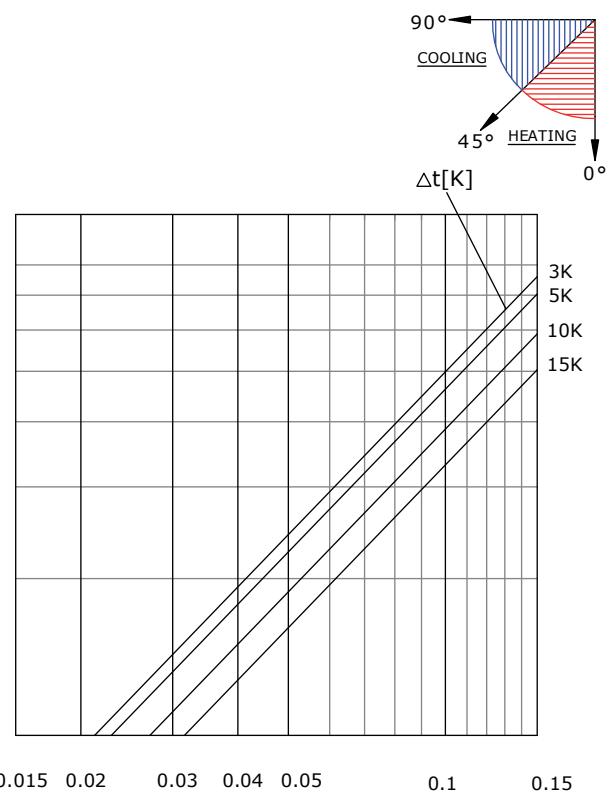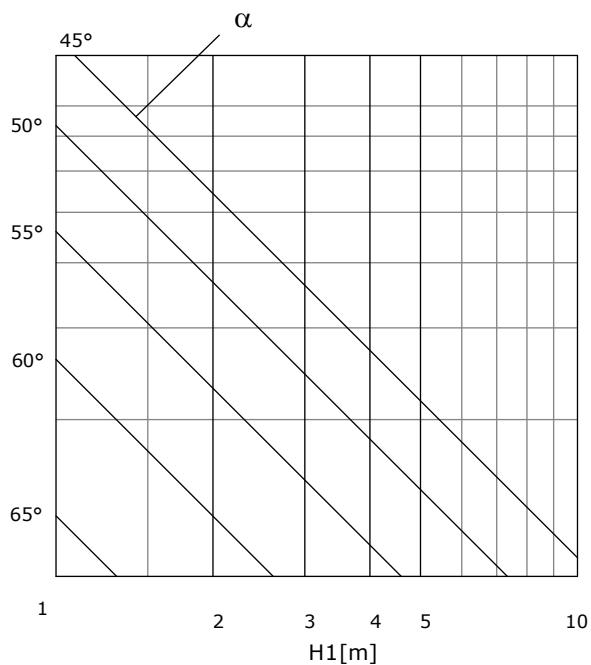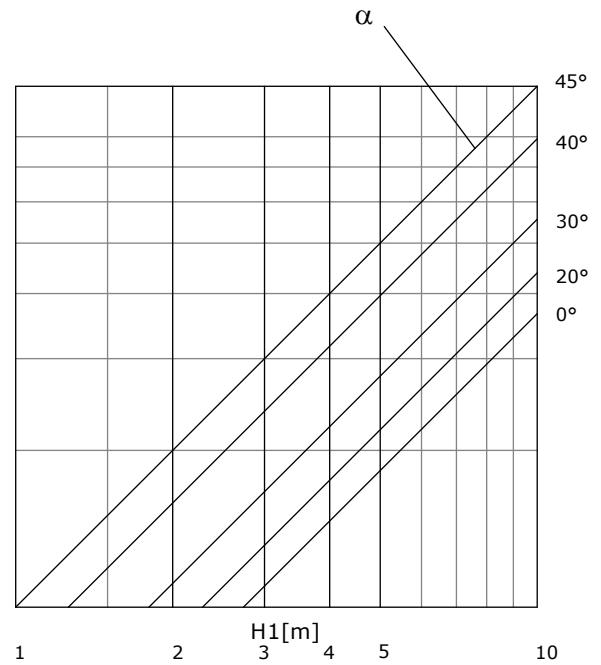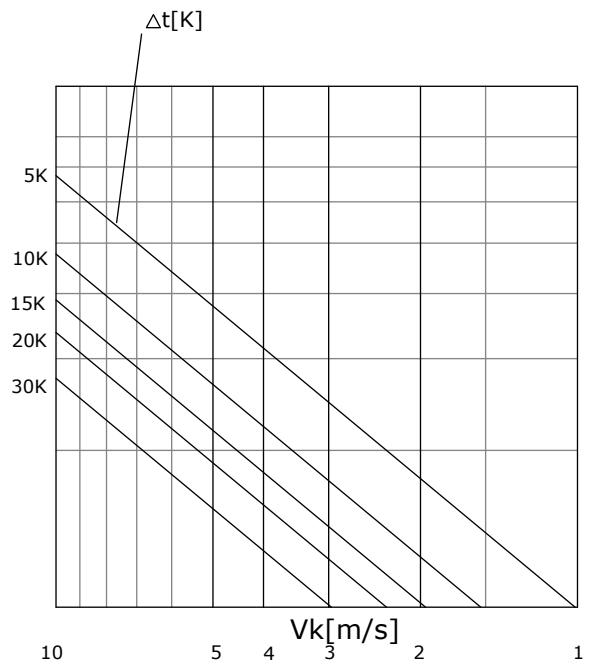$\alpha$  -setting RWR-4 250COOLINGHEATING



**Angle setting size 315**

$\alpha$  -setting RWR-4 315

## COOLING

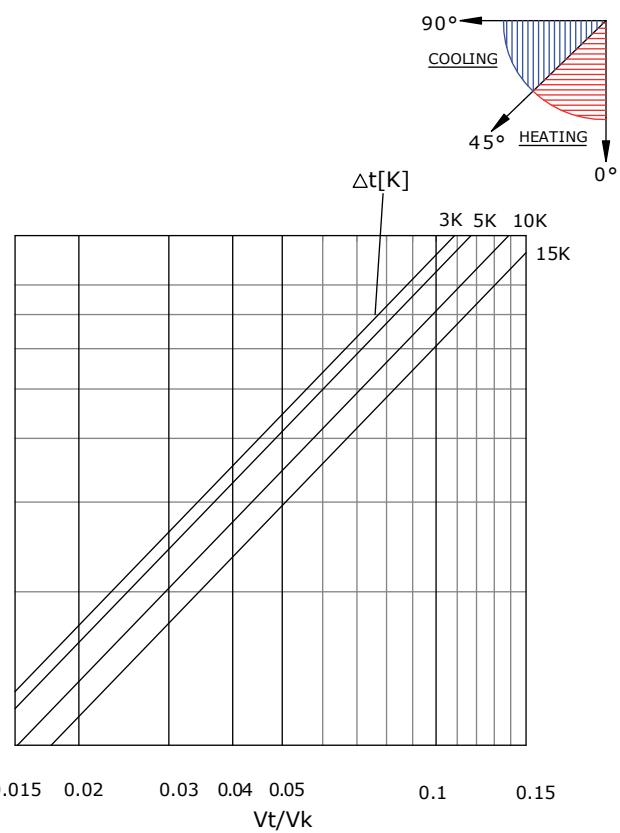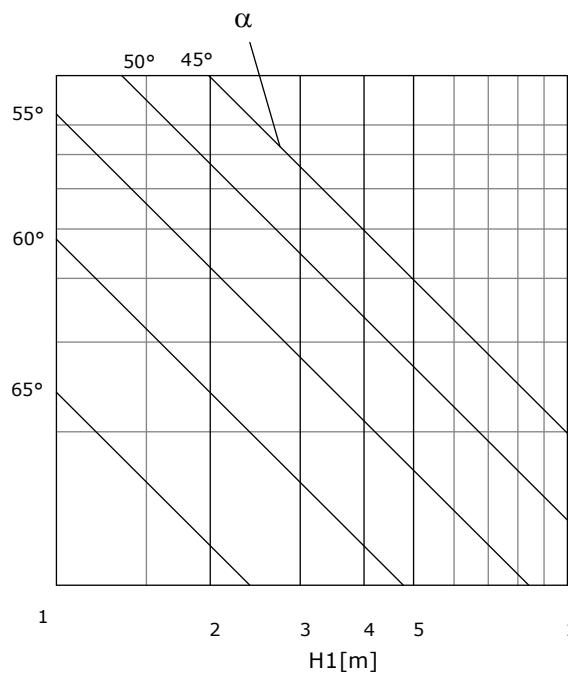


## HEATING

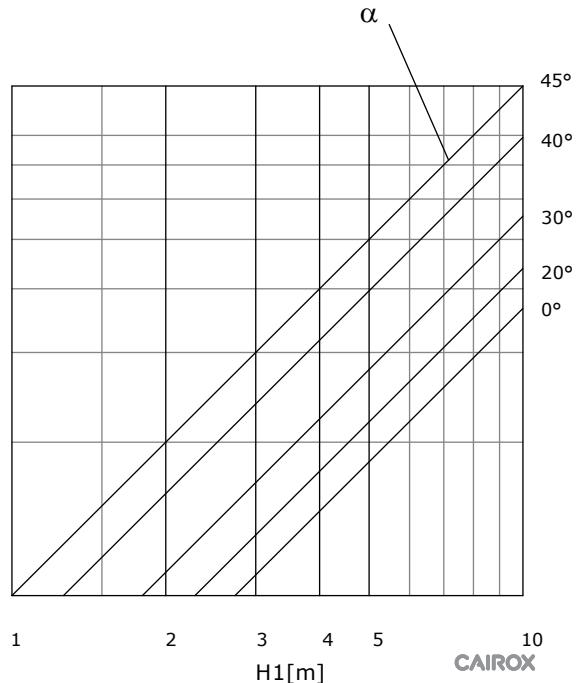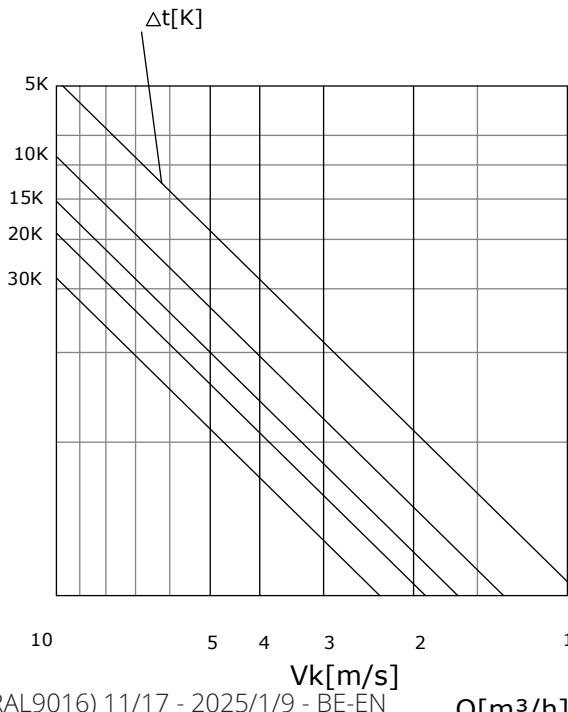



**Angle setting size 400**

$\alpha$  -setting RWR-4 400





## COOLING

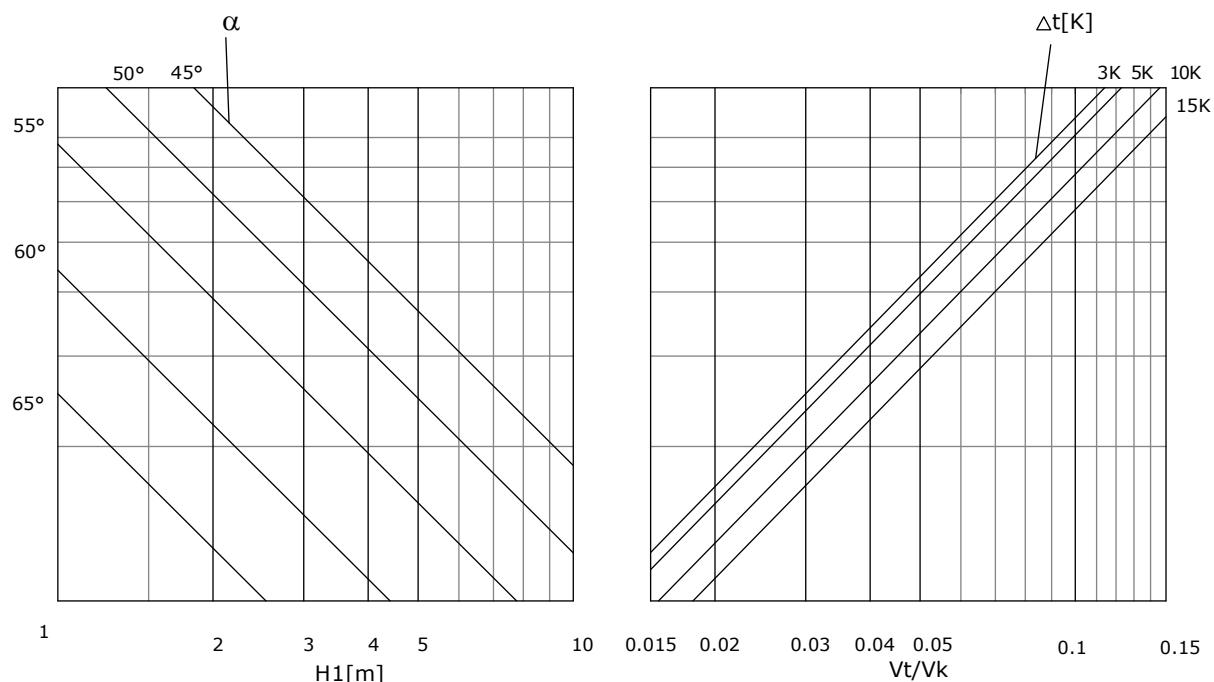

## HEATING

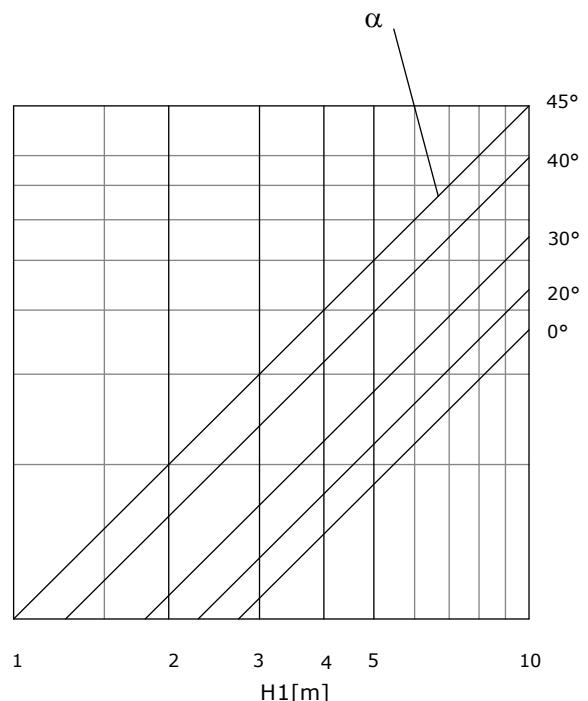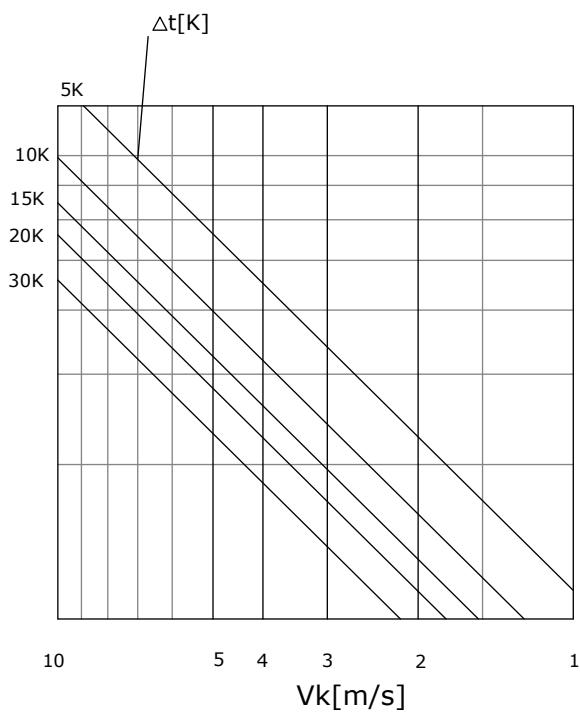



**Angle setting size 500**

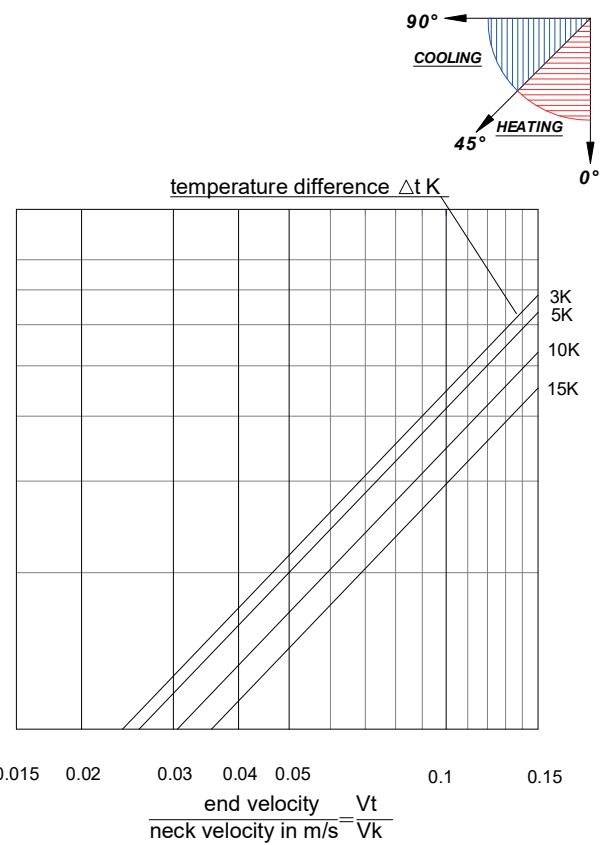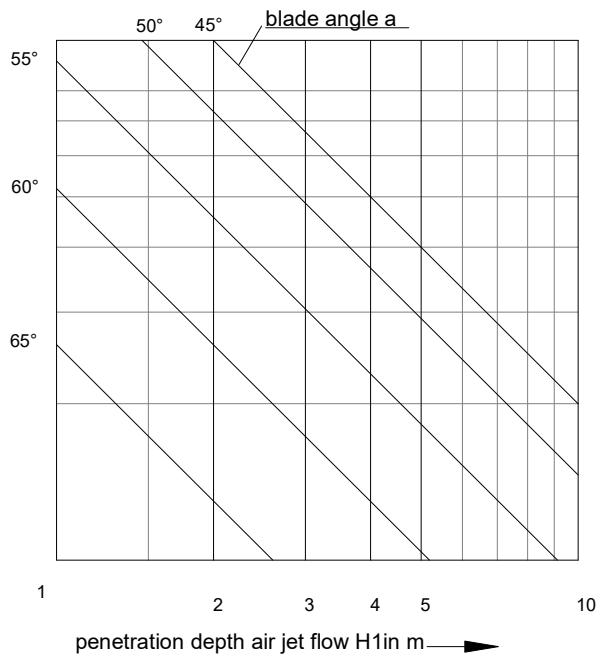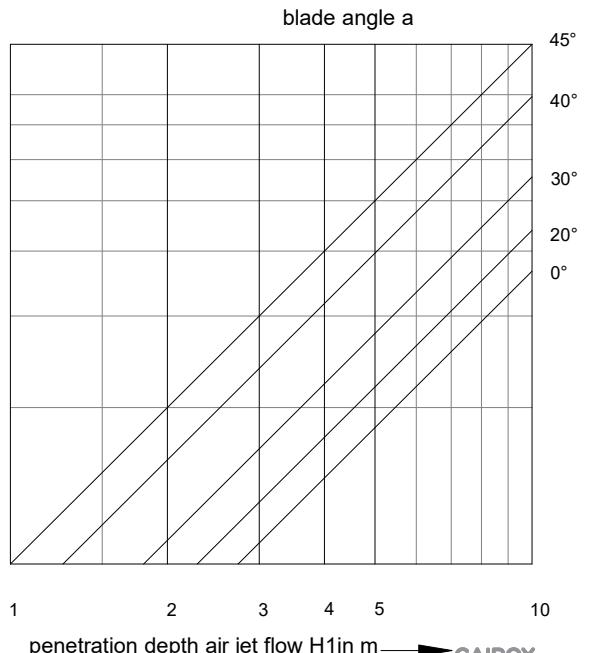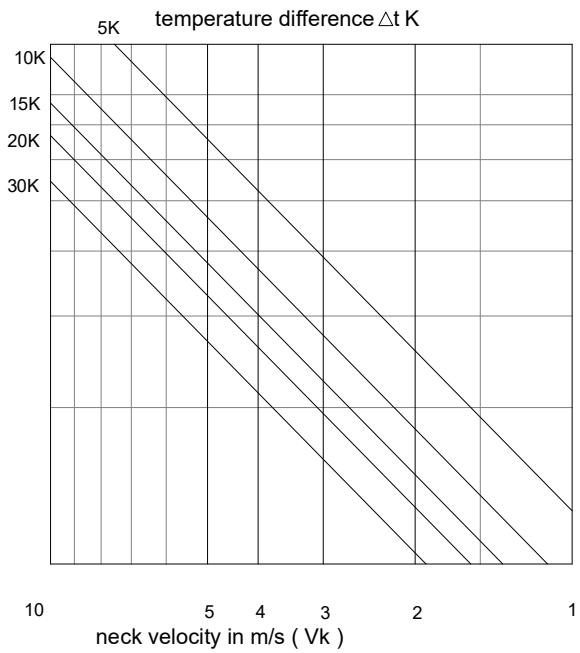$\alpha$ -setting RWR-4 500**COOLING****HEATING**

**Angle setting size 630**

$\alpha$  -setting RWR-4 630

## COOLING

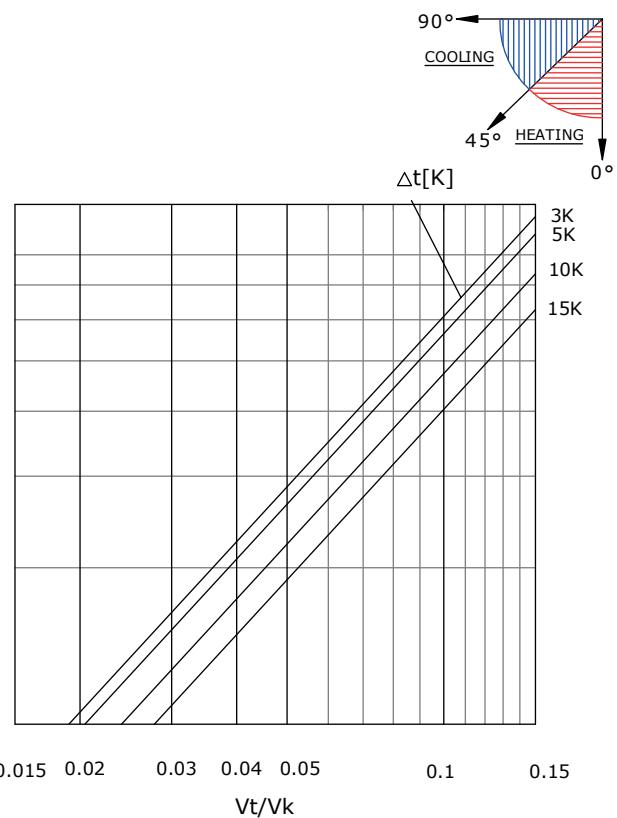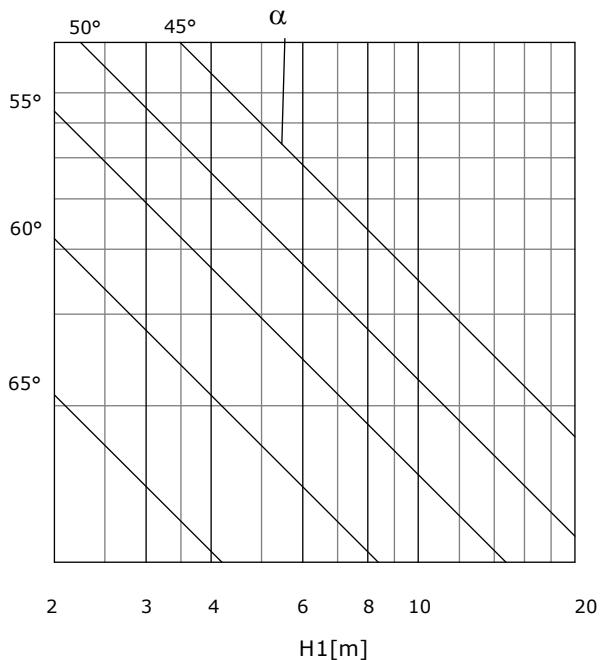

## HEATING

