

**RWR-FSA  
(RAL9016)**

- Swirl diffusers
- Circular
- Steel
- White, RAL 9016



## Circular swirl diffusers with fixed blades type RWR-FSA (RAL9016)

Swirl ceiling diffusers with high induction rate, consisting of a circular plate with multiple fixed blades arranged in a circular pattern, to be equipped with galvanized steel plenum box.

### **Brand**

- Cairox

### **Application**

- For air supply and exhaust in ventilation and air conditioning systems

### **Material**

- Steel

### **Colour**

- Standard colour white, RAL 9016
- Other colours available upon request

### **Composition**

- Front plate made of powder coated steel
- Central screw mounting

### **Mounting**

- Fixing by central screw in the crossbar of the plenum box.

### **Accessories**

- Circular plenum box, type **RER-B**
- Insulated circular plenum box, type **RER-B ISO**
- Regulating valve for plenum box, type **CRC**

**Text for tender**

- The air supply ceiling diffusers are circular with a circular arranged swirl with fixed blades. They are made of a steel powdercoated frontplate in white finish RAL 9016. The diffusers are standard delivered with galvanized steel plenumbox equipped with perforated plate and damper in the side entry spigot. The diffuser is centrally screw mounted.

- Cairox type RWR-FSA + RER-A**

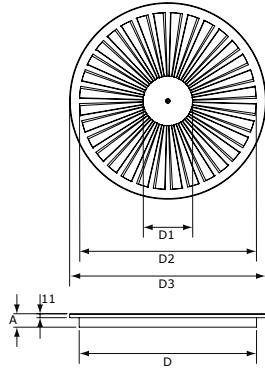
**Order example**

- RWR-FSA, 600/540 + RER-B 600 + CRC 250**

Explanation

**RWR-FSA** = Diffuser type**600/540** = Diffuser size/swirl size

Accessories

**RER-B** = Type plenum box**600** = Size plenum box**CRC** = Regulating valve for plenum box**250** = Plenum box connection diameter 250

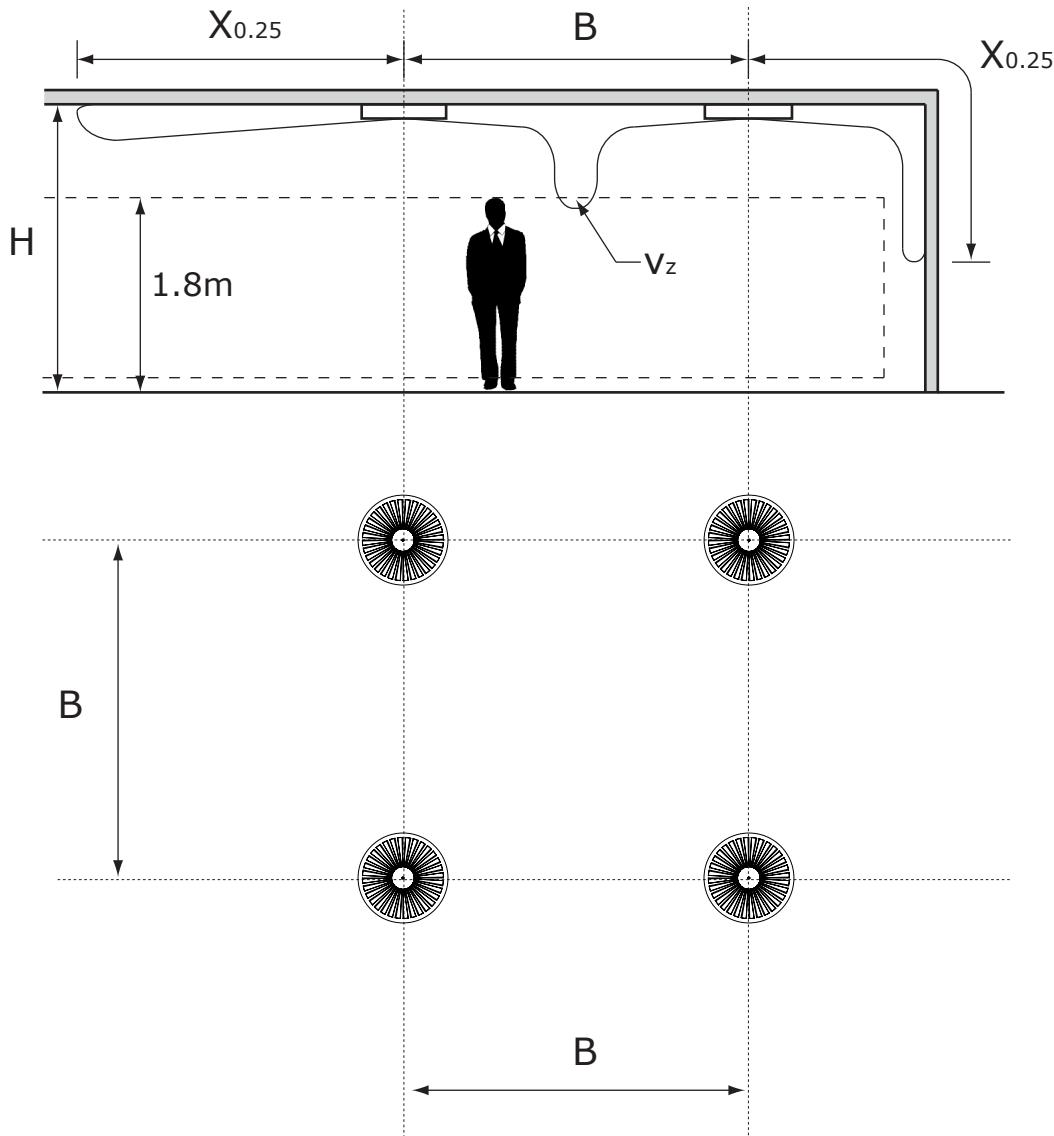
Dimensions						
	D [mm]	D1 [mm]	D2 [mm]	D3 [mm]	A	#Blades
<b>RWR-FSA 300</b>	238	100	236	296	41	28
<b>RWR-FSA 400</b>	338	150	336	396	41	30
<b>RWR-FSA 500</b>	438	150	436	496	41	32
<b>RWR-FSA 600</b>	538	150	536	596	22	32
<b>RWR-FSA 625*</b>	538	150	536	621	22	32

\* niet meer verkrijgbaar / n'est plus disponible / no longer available

Quick selection																	
RWR-FSA			300			400			500			600			625*		
Q	Ak		0.01			0.016			0.033			0.049			0.049		
	H= 2.7	0.2	0.15	0.12	0.15	0.11	0.09										
100	H= 3.2	0.15	0.12	0.1	0.11	0.09	0.07										
	H= 3.8	0.12	0.1	0.08	0.09	0.07	0.06										
	Vz				2.8		1.7										
	Vk																
	X0,25				1.2		0.8										
150	Ps				3		2										
	Lw(A)				<20		<20										
	Vz	H= 2.7	0.3	0.22	0.17	0.22	0.17	0.13	0.16	0.12	0.1						
	H= 3.2	0.23	0.18	0.15	0.17	0.14	0.11	0.13	0.1	0.08							
	H= 3.8	0.18	0.15	0.13	0.14	0.11	0.1	0.1	0.08	0.07							
200	Vk		4.2			2.6			1.3								
	X0,25		1.8			1.3			0.9								
	Ps		8			5			3								
	Lw(A)		30			21		<20									
	Vz	H= 2.7			0.3	0.22	0.18	0.21	0.16	0.13	0.14	0.1	0.08	0.14	0.1	0.08	
250	H= 3.2		0.23	0.18	0.15	0.16	0.13	0.13	0.11	0.09	0.09	0.07	0.11	0.09	0.07	0.06	
	H= 3.8		0.18	0.15	0.13	0.14	0.11	0.09	0.09	0.07	0.06	0.06	0.09	0.07	0.06	0.06	
	Vk				3.5			1.7			1.1			1.1			
	X0,25				1.9			1.2			0.7			0.7			
	Ps				9			4			2			2			
300	Lw(A)							<20			<20			<20			
	Vz	H= 2.7			0.37	0.27	0.22	0.26	0.2	0.16	0.18	0.13	0.11	0.18	0.13	0.11	
	H= 3.2		0.29	0.23	0.19	0.2	0.16	0.14	0.14	0.11	0.1	0.14	0.11	0.09	0.09	0.08	
	H= 3.8		0.23	0.19	0.16	0.16	0.14	0.12	0.11	0.09	0.08	0.11	0.09	0.09	0.09	0.08	
	Vk				4.3			2.1			1.4			1.4			
400	X0,25				2.3			1.6			1			1			
	Ps				13			7			3			3			
	Lw(A)				33			22			<20			<20			
	Vz	H= 2.7			0.31	0.23	0.19	0.21	0.16	0.13	0.21	0.16	0.13	0.21	0.16	0.13	
	H= 3.2		0.24	0.19	0.16	0.19	0.16	0.14	0.17	0.14	0.11	0.17	0.14	0.11	0.14	0.11	
500	H= 3.8		0.19	0.16	0.14	0.12	0.11	0.09	0.09	0.07	0.06	0.14	0.11	0.11	0.14	0.11	
	Vk				2.5						1.7			1.7			
	X0,25				1.9						1.2			1.2			
	Ps				10						4			4			
	Lw(A)				27			<20			<20			<20			
600	Vz	H= 2.7			0.42	0.32	0.25	0.29	0.22	0.18	0.29	0.22	0.18	0.29	0.22	0.18	
	H= 3.2		0.33	0.26	0.22	0.23	0.19	0.18	0.18	0.15	0.13	0.23	0.18	0.15	0.23	0.13	
	H= 3.8		0.26	0.22	0.19	0.22	0.19	0.18	0.15	0.13	0.18	0.23	0.18	0.15	0.23	0.13	
	Vk				3.4			2.3						2.3			
	X0,25				2.7			1.8						1.8			
700	Ps				18			8						8			
	Lw(A)				35			26						26			
	Vz	H= 2.7			0.52	0.39	0.31	0.35	0.27	0.22	0.35	0.27	0.22	0.35	0.27	0.22	
	H= 3.2		0.41	0.32	0.27	0.28	0.22	0.19	0.22	0.19	0.16	0.28	0.22	0.19	0.22	0.19	
	H= 3.8		0.32	0.27	0.23	0.22	0.19	0.16	0.22	0.19	0.16	0.22	0.19	0.16	0.22	0.16	
600	Vk				4.2			2.8						2.8			
	X0,25				3.5			2.3						2.3			
	Ps				27			12						12			
	Lw(A)				40			31						31			
	Vz	H= 2.7			0.43	0.32	0.26	0.43	0.32	0.26	0.43	0.32	0.26	0.43	0.32	0.26	
700	H= 3.2		0.34	0.27	0.23	0.34	0.27	0.2	0.34	0.27	0.23	0.34	0.27	0.23	0.34	0.27	
	H= 3.8		0.27	0.23	0.2	0.27	0.23	0.2	0.27	0.23	0.2	0.27	0.23	0.2	0.27	0.2	
	Vk				3.4			2.9						2.9			
	X0,25				17			12						12			
	Ps				37			37						37			
700	Lw(A)				4			4						4			
	Vz	H= 2.7			0.5	0.38	0.31	0.5	0.38	0.31	0.5	0.38	0.31	0.5	0.38	0.31	
	H= 3.2		0.4	0.32	0.27	0.4	0.32	0.27	0.4	0.32	0.27	0.4	0.32	0.27	0.4	0.32	
	H= 3.8		0.32	0.27	0.23	0.32	0.27	0.23	0.32	0.27	0.23	0.32	0.27	0.23	0.32	0.23	
	Vk				3.5			3.5						3.5			
700	X0,25				24			24						24			
	Ps				41			41						41			
	Lw(A)				41			41						41			

### Symbols and specifications

- Q = Air volume in m<sup>3</sup>/h
- Ak = Effective surface (free area) in m<sup>2</sup>
- B = Distance between the diffusers in m
- H = Installation height of the diffusers in m
- Vz = Maximum velocity at the occupied zone according to distance between the diffusers and installation height in m/s
- Vk = Average effective velocity through the diffuser in m/s
- X0,25 = Throw length in m at an end velocity Vt of 0,25m/s
- Ps = Static pressure loss given in Pa
- Lw(A) = Acoustic power in dB(A)
- The throw X0,25 is given at an end velocity of 0.25m/s for a smooth ceiling without any obstacles.
- The values are given for isothermal supply air. Throw distances for cooling conditions at -11K can be calculated by dividing the X0,25 values with factor 1.1. For heating purposes at Dt of +11K a multiplier of 1.1 should be applied to the given X0,25 value.
- In order to achieve a high comfort level, selections can be made according to the maximal velocity at the occupied zone Vz. These values are given at distances between diffusers B and installation heights H. Velocities Vz lower than, or equal to 0,25m/s at the occupied zone are advised.
- The pressure losses Ps are given for diffusers without damper of with fully opened damper.
- The acoustic power values Lw(A) are given for diffusers without damper of with fully opened damper without room attenuation. Acoustic powers below 20dB(A) are mentioned as "<20" in the tables.
- For all special requirements, please contact our engineering office.

**Placement instruction**

**RER-B**

- Plenum boxes
- Circular
- Steel



## Circular plenum box type RER-B

Universal circular plenum boxes with perforated plate in galvanized steel

**Brand**

- Cairox

**Composition**

- Circular body in plain steel plate
- Crossbar for central mounting with M6 screw of diffuser
- Perforated equalizing plate for equal air diffusion inside the box
- Circular connection spigot
- Seal for airtight connection with the diffuser

**Accessories**

- Circular value control damper , type **CRC**

**Order example**

- **RER-B 600 + CRC 250**

Explanation

**RER-B** = Plenum box type

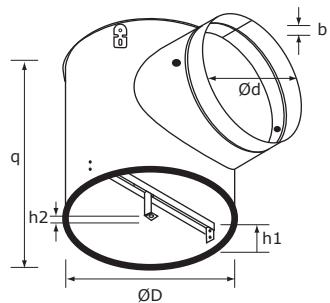
**600** = Size type

Accessory

**CRC 250** = Regulating valve for plenum box connection Ø250

**Other available products**

- Insulated plenumboxes type **RER-B ISO**



Dimensions						
RER-B	ØD [mm]	q [mm]	Ød [mm]	b [mm]	h1 [mm]	h2 [mm]
300	275	230	160	15	65	10
400	375	270	200	15	65	10
500	476	270	200	15	65	10
600	576	320	250	15	65	10